



TOOLED JOINT SPACED TO MATCH SIDEWALK WIDTH ± MATCH CURB & GUTTER JOINT WHERE POSSIBLE

EXPANSION JOINT SPACED 100' MAX.

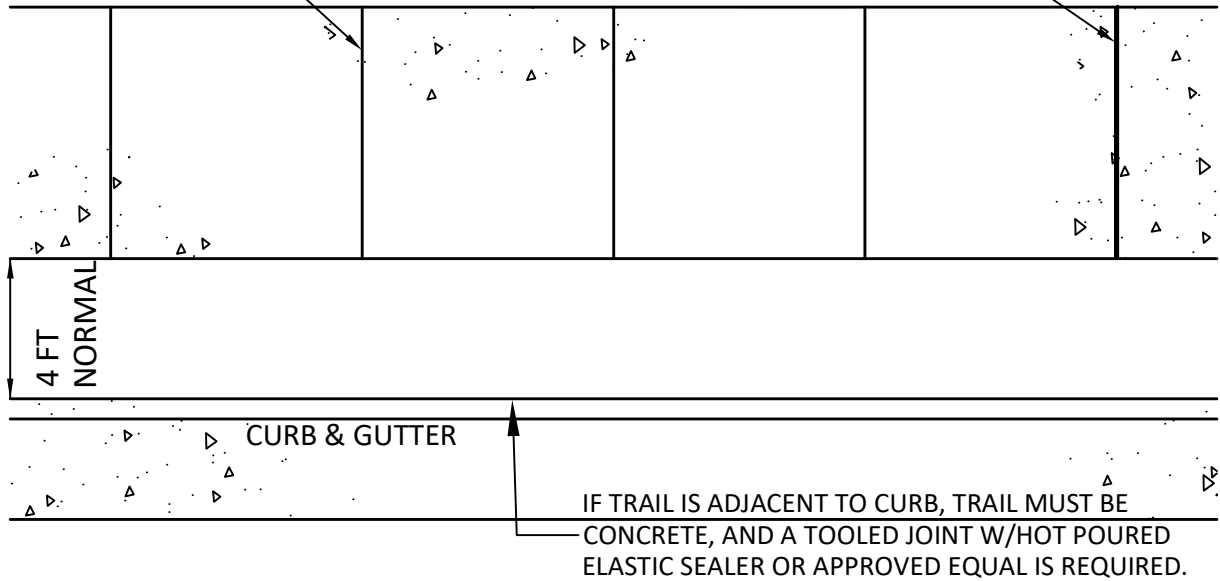

PATH NEAR CURB

ALL BIKE PATHS SHALL BE A MINIMUM OF 6 INCH THICK 4000 PSI CONCRETE WITH A MINIMUM OF 4 INCHES OF COMPACTED CUSHION MATERIAL PLACED UNDER THE SIDEWALK. 4 INCH THICKNESS IS ALLOWED TO MATCH EXISTING OR WITH CITY MANAGER APPROVAL. ASPHALT (MIN DEPTH IS 4 INCHES) REQUIRES APPROVAL FROM CITY MANAGER.

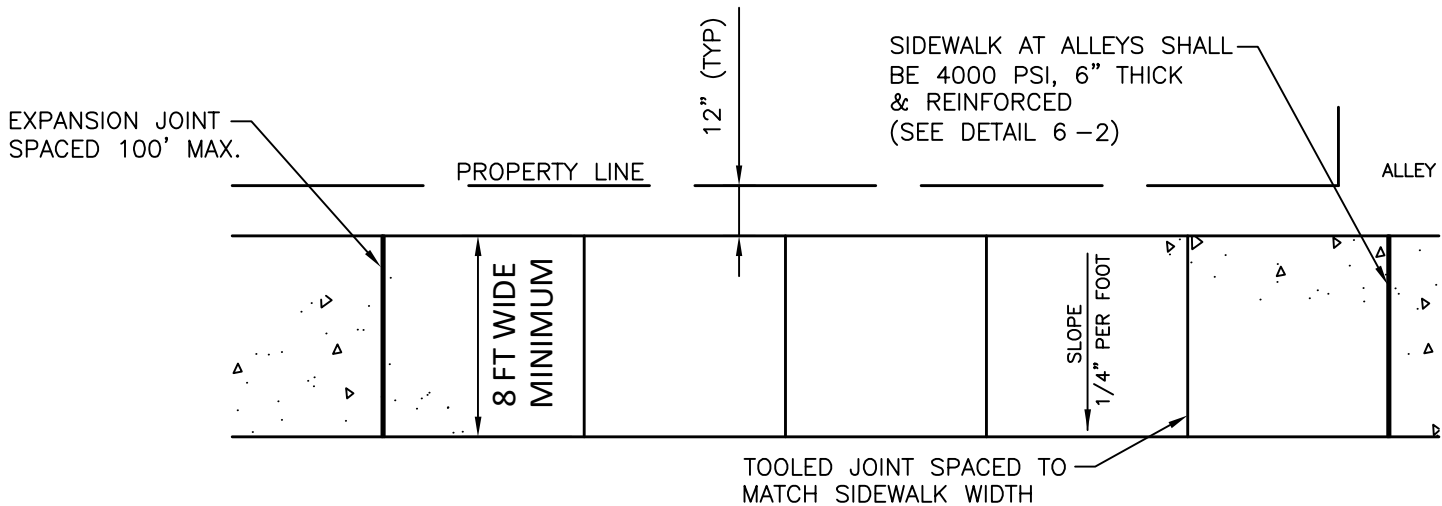

PROPERTY LINE BIKE PATH

FINISH SHALL BE BROOMED PERPENDICULAR TO THE DIRECTION OF TRAVEL. CROSS SLOPE SHALL BE A MAXIMUM OF 2%.